


PLAN

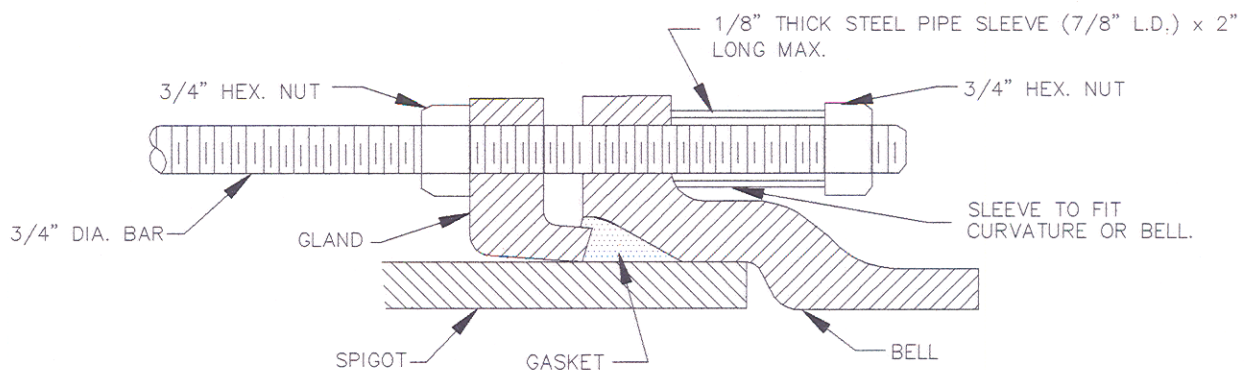

CROSS SECTION  
SLEEVE AND BAR ASSEMBLY

NOTES:

1. USE MECHANICAL JOINT FITTINGS ONLY.
2. FOR ALTERNATE METHOD OF STRAPPING VALVE TO MAIN SEE DETAIL B/2.03  
APPLY TWO COATS OF BITUMINOUS PAINT TO BARS AND APPURTENANCES.

VALVE SIZE	NUMBER OF 3/4" DIA. BARS REQUIRED	MAX. LENGTH OF SPIGOT PIPE
3"	2	24"
4"	2	24"
6"	2	27"
8"	2	27"
10"	4	27"
12"	6	27"
16"	8	36"
20"	12	36"
24"	16	36"
30"	20	42"

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

DIRECTOR OF DEVELOPMENT SERVICES

DATE

WATER / SEWER ENGINEER

DATE

STANDARD DETAIL  
METHOD OF STRAP-  
PING VALVE TO MAIN

REVISIONS:

B  
2.00

93